

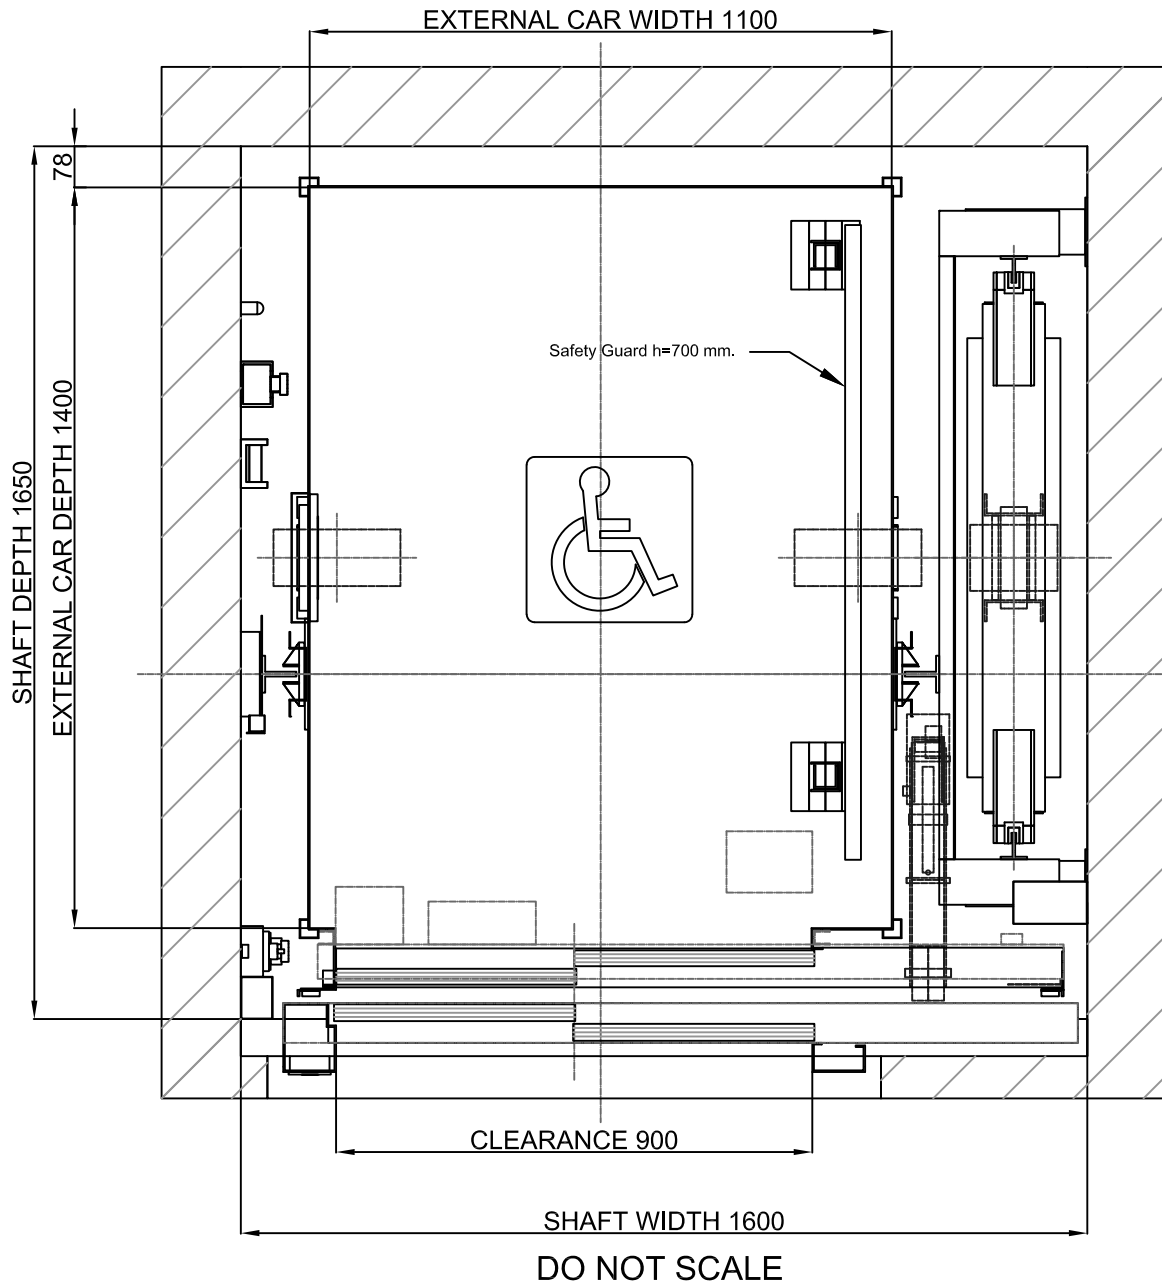


# 01-PLAN VIEW

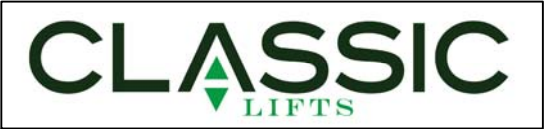

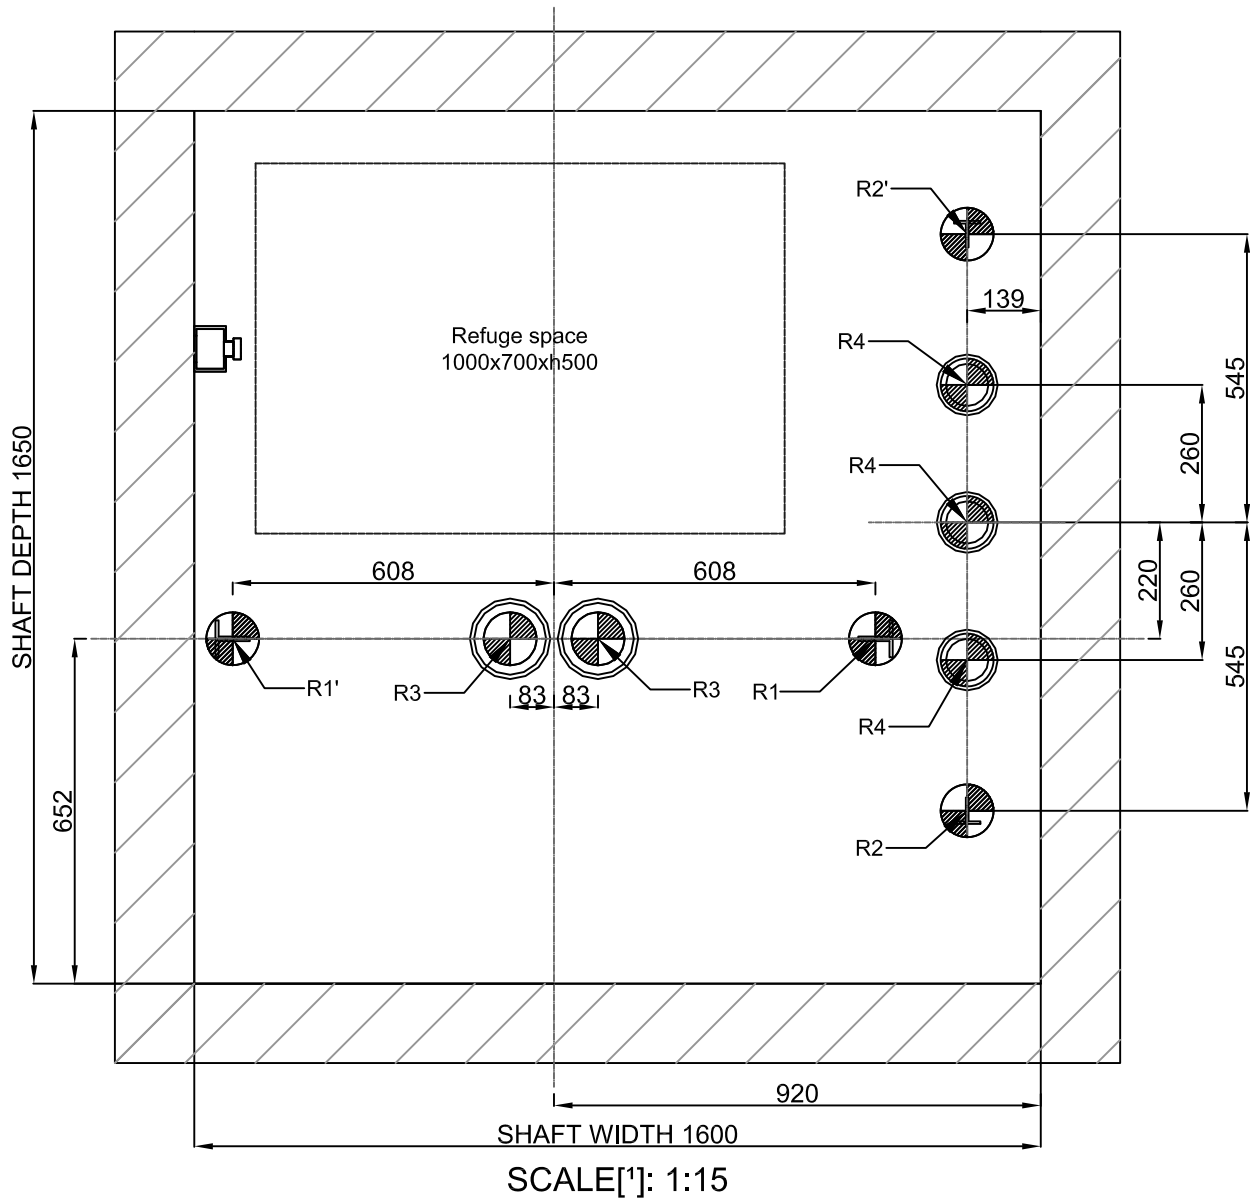

DRAWING	DATE	REV.	SHEET	[*] Unbounded dimensions in drawings are indicative and not binding.
		00	1	REFERENCE: MPGO!EVOLUTION630ST2_EN
MODEL LIFT:				CLIENT: WORK SITUATION:
CLASSIC LIFTS - EVOLUTION				
CAPACITY: [N° PERSONS]	8			
NOMINAL LOAD: [kg]	630			
SPEED: [m/s]	1			
FREQUENCY: [Hz]	50			
TENSION: [V]	400V [Three-phase]			

# 05-PIT LAYOUT




REACTIONS [N] [max.]			
R1	30000	R2	22000
R1'	26000	R2'	23000
R3	31500	R4	17000
N	2000	T	1100



DRAWING	DATE	REV.	SHEET	[*] Unbounded dimensions in drawings are indicative and not binding.
		00	3	REFERENCE: MPGO!EVOLUTION630ST2_EN
MODEL LIFT:				CLIENT: WORK SITUATION:
CLASSIC LIFTS - EVOLUTION				
CAPACITY: [N° PERSONS]		8		
NOMINAL LOAD: [kg]		630		
SPEED: [m/s]		1		
FREQUENCY: [Hz]		50		
TENSION: [V]		400V [Three-phase]		

# 02-SIDE VERTICAL SECTION

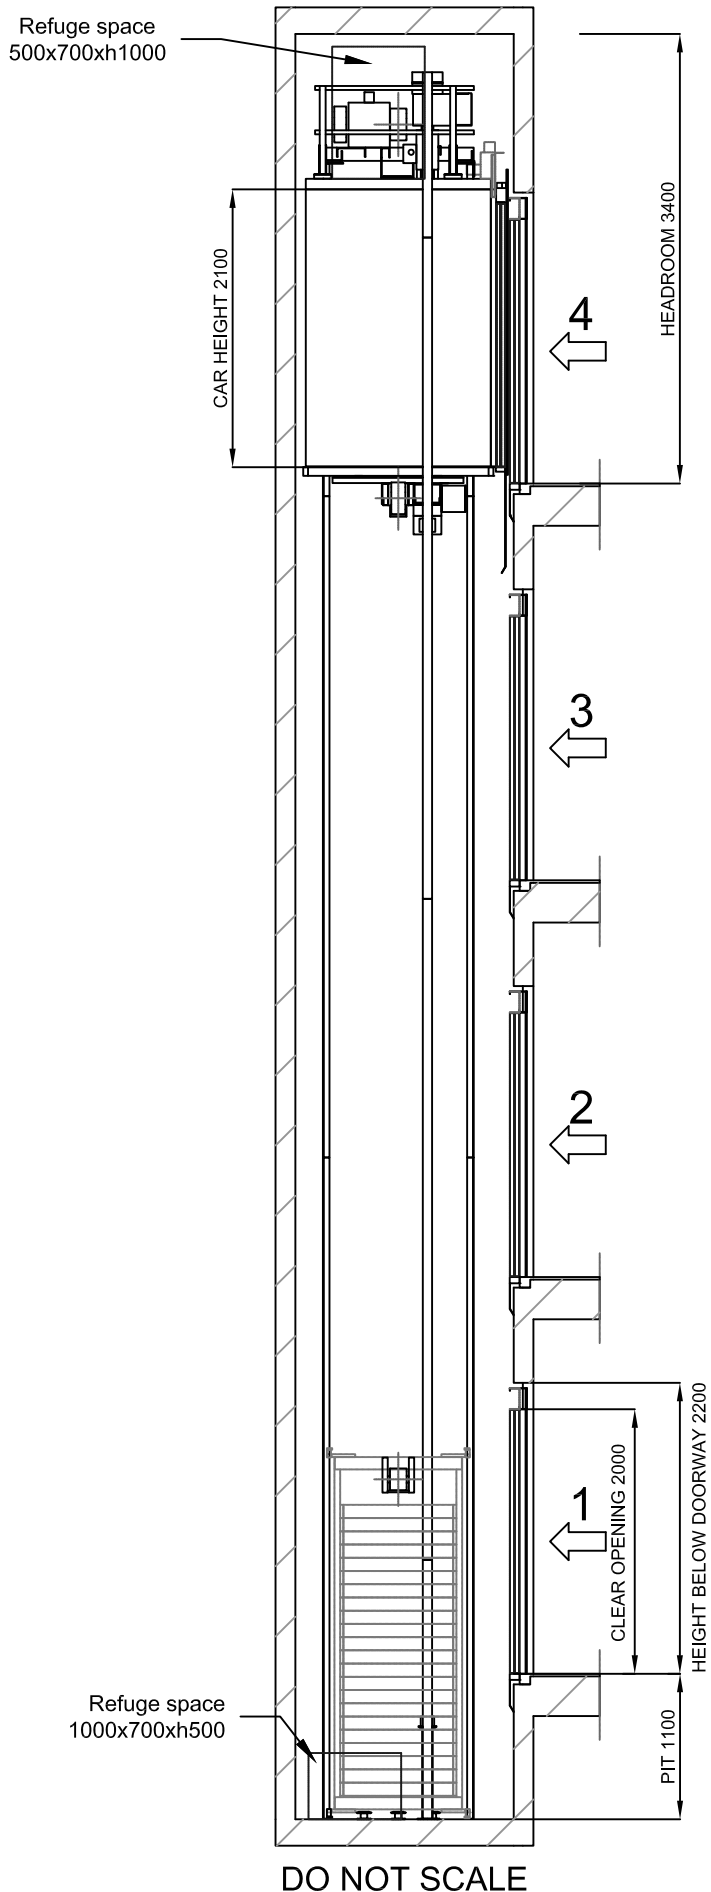

[\*] Unbounded dimensions in drawings are indicative and not binding.

REFERENCE:

MPGO!EVOLUTION630ST2\_EN

CLIENT:

WORK SITUATION:

**CLASSIC**  
LIFTS

DRAWING DATE REV. SHEET

00 2

MODEL LIFT:

CLASSIC LIFTS - EVOLUTION

CAPACITY: [N° PERSONS] 8

NOMINAL LOAD: [kg] 630

SPEED: [m/s] 1

FREQUENCY: [Hz] 50

TENSION: [V] 400V [Three-phase]

Flat and levelled floor, protected against water leaking.

[EN81-20:2014 5.2.1.9]

Foresee pit access device

[EN81-20:2014 5.2.2.4]

Stop device

[EN81-20:2014 5.2.1.5.1. a]

Inspection control station.

[EN81-20:2014 5.2.1.5.1. b]

Power supply

[EN81-20:2014 5.2.1.5.1. c]

Light switch

commuted with the cabinet.

[EN81-20:2014 5.2.1.5.1. d]