
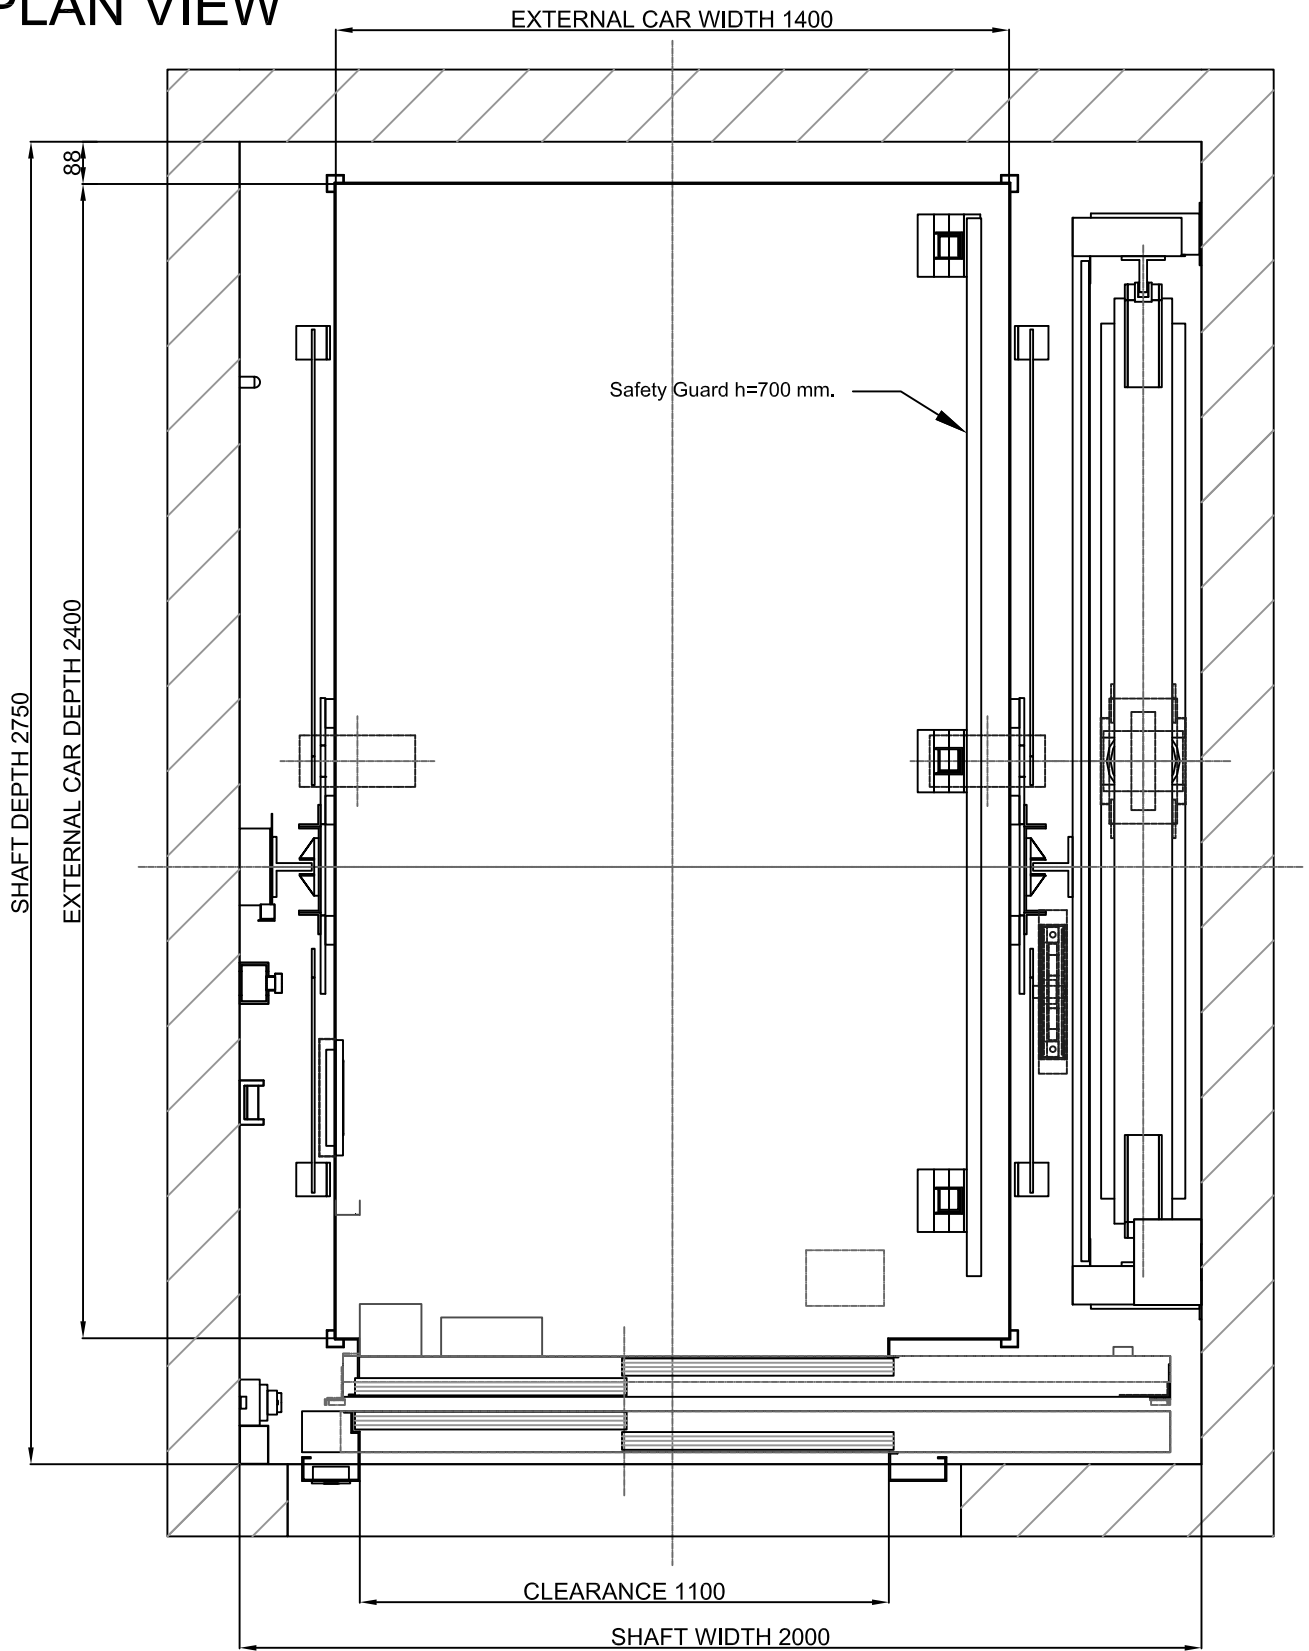



01-PLAN VIEW

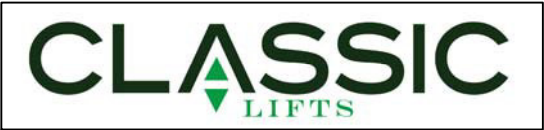

DO NOT SCALE


DRAWING	DATE	REV.	SHEET	[*] Unbounded dimensions in drawings are indicative and not binding.
		00	1	
MODEL LIFT:				REFERENCE:
CLASSIC LIFTS - EVOLUTION				MPGO!EVOLUTION630ST2_EN
CAPACITY: [N° PERSONS]				CLIENT:
NOMINAL LOAD: [kg]				WORK SITUATION:
SPEED: [m/s]				
FREQUENCY: [Hz]				
TENSION: [V]				
		400V [Three-phase]		

05-PIT LAYOUT

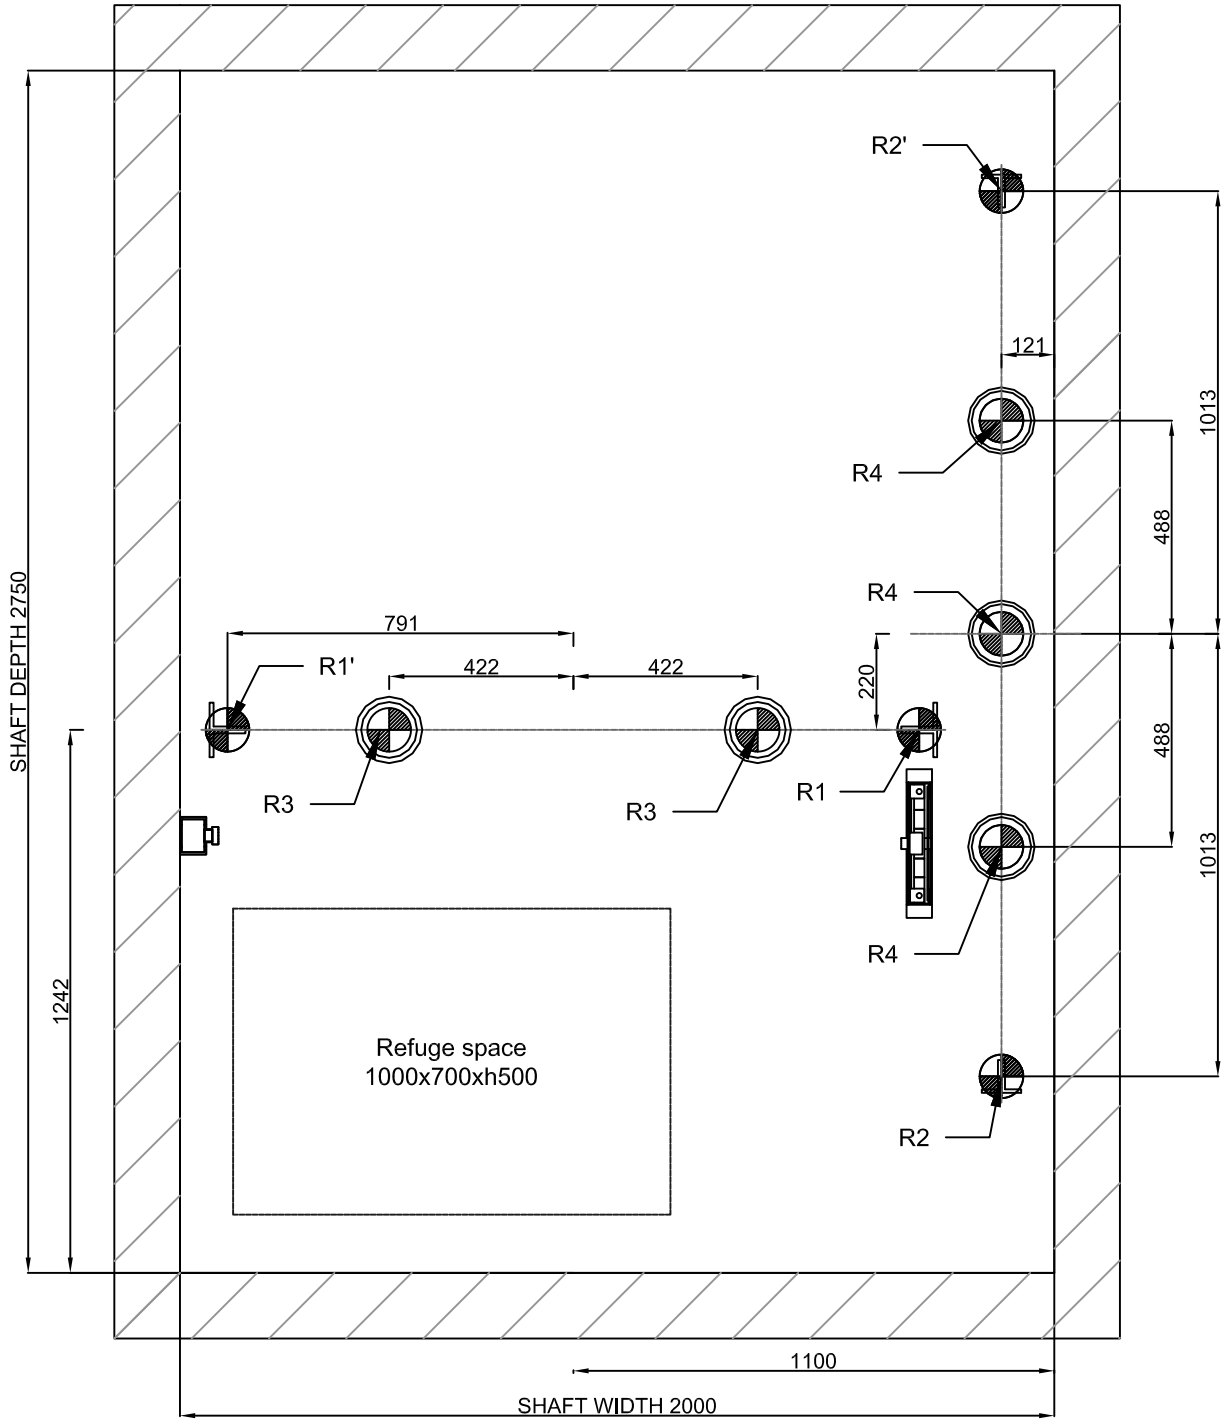

REACTIONS [N] [max.]

R1	33500	R2	34500
R1'	33500	R2'	34500
R3	68000	R4	34700
Sx	1960	Sy	1160



DO NOT SCALE

DRAWING DATE REV. SHEET

00 1

[*] Unbounded dimensions in drawings are indicative and not binding.

REFERENCE: **DO NOT SCALE**
MPGO!EVOLUTION630ST2_EN

MODEL LIFT:

CLASSIC LIFTS - EVOLUTION

CAPACITY: [N° PERSONS] 13

NOMINAL LOAD: [kg] 1000

SPEED: [m/s] 1


FREQUENCY: [Hz] 50

TENSION: [V] 400V [Three-phase]

CLIENT:
WORK SITUATION:

CLASSIC
LIFTS

02-SIDE VERTICAL SECTION

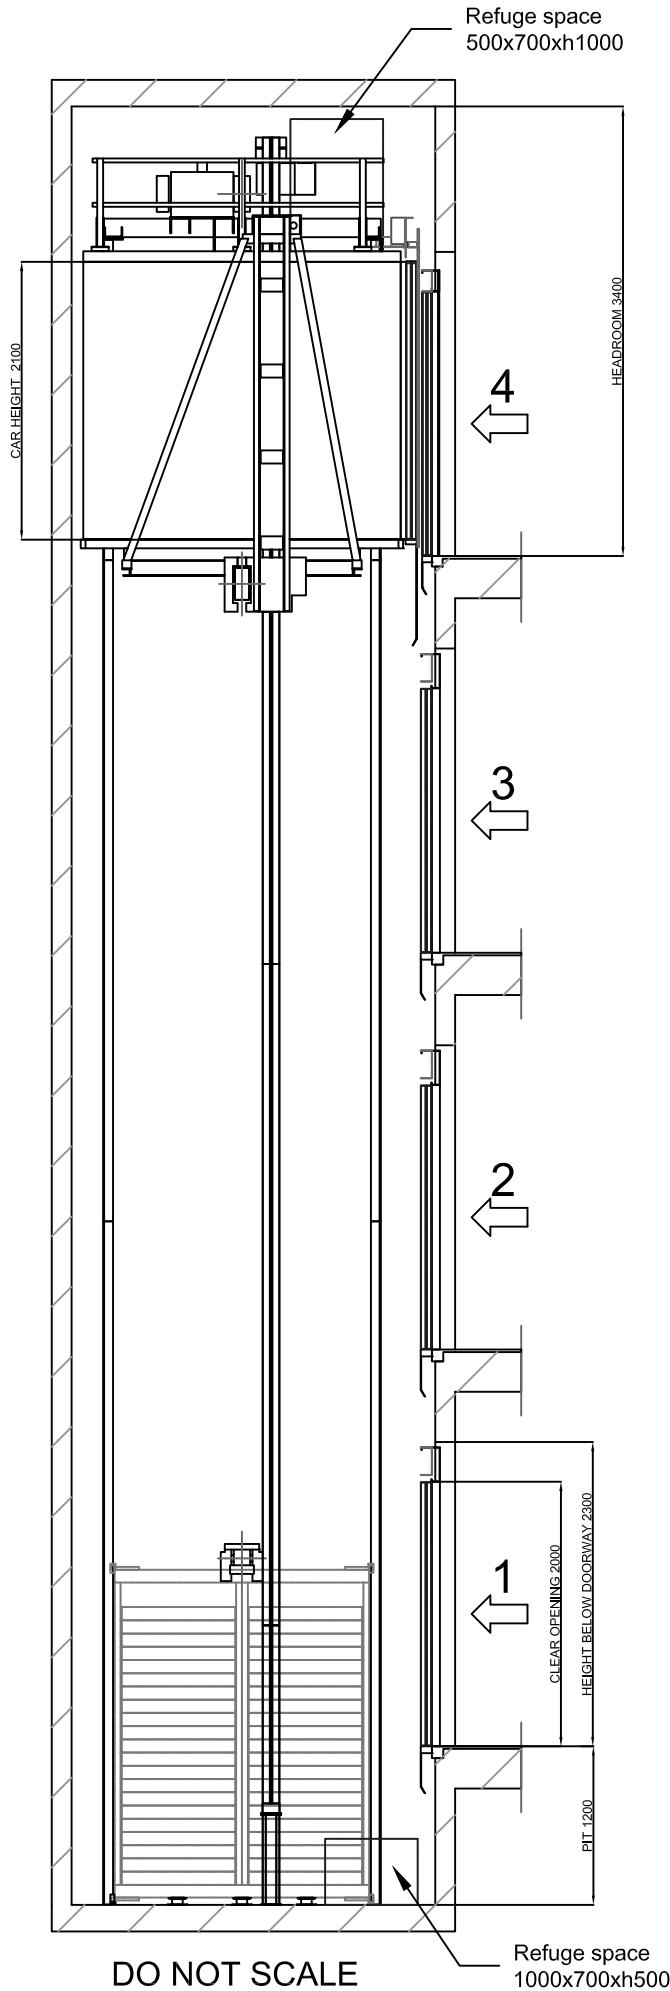

[*] Unbounded dimensions in drawings are indicative and not binding.

REFERENCE:

MPGO!EVOLUTION630ST2_EN

CLIENT:

WORK SITUATION:

CLASSIC
LIFTS

DRAWING	DATE	REV.	SHEET
		00	2
MODEL LIFT:			
CLASSIC LIFTS - EVOLUTION			
CAPACITY: [N° PERSONS]	21		
NOMINAL LOAD: [kg]	1600		
SPEED: [m/s]	1		
FREQUENCY: [Hz]	50		
TENSION: [V]	400V [Three-phase]		

Flat and levelled floor, protected against water leaking.

[EN81-20:2014 5.2.1.9]

Foresee pit access device

[EN81-20:2014 5.2.2.4]

Stop device

[EN81-20:2014 5.2.1.5.1. a]

Inspection control station.

[EN81-20:2014 5.2.1.5.1. b]

Power supply

[EN81-20:2014 5.2.1.5.1. c]

Light switch

commuted with the cabinet.

[EN81-20:2014 5.2.1.5.1. d]